

TEST PADS 1 & 2


- PROVIDE AND INSTALL (2) - 30A TWISTLOCK OUTLET W/ CONDUIT & CONDUCTORS CAPABLE OF 60 AMPS
- PROVIDE A 5KVA 480:120/240 SINGLE PHASE TRANSFORMER WITH (2) - DOUBLE DUPLEX GFCI OUTLETS
- PROVIDE A DATA OUTLET
- INSTALL AIR LINE (MATERIAL PROVIDED BY GC)

TEST PADS 3, 4, 5, 6, & 7

- PROVIDE AND INSTALL (2) - 30A TWISTLOCK OUTLETS RECEPTACLES
- PROVIDE A 5KVA 480:120/240 SINGLE PHASE TRANSFORMER WITH (2) - DOUBLE DUPLEX GFCI OUTLETS
- PROVIDE A DATA OUTLET
- INSTALL AIR LINE (MATERIAL PROVIDED BY GC)

SITE ELECTRICAL PLAN

SCALE: 1" = 50'

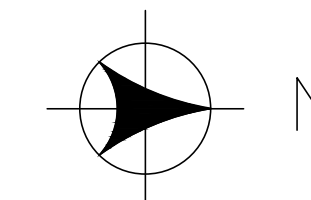

| NO.  | DATE       | REVISION | BY |
|--|------------|----------|----|
|  |            |          |    |
|  |            |          |    |
|  |            |          |    |
|  |            |          |    |
|  |            |          |    |
|  |            |          |    |
| DWG TITLE  |            |          |    |
| <b>ATLEC</b><br>DESIGN ASSURANCE<br>SITE LIGHTING<br>DISTRIBUTION PLAN |            |          |    |
| ENGINEER   | CHECKED BY |          |    |
| JOB NO   | DRAWN BY   |          |    |
| SCALE  | DATE       |          |    |
| DWG NO   |            |          |    |
| SHEET NO   |            |          |    |
| 2 OF 13  |            |          |    |